


PENKO Engineering B.V.

Your Partner for Fully Engineered Factory Solutions



Manual:
SGM800 Supplement Belt Weigher Controller

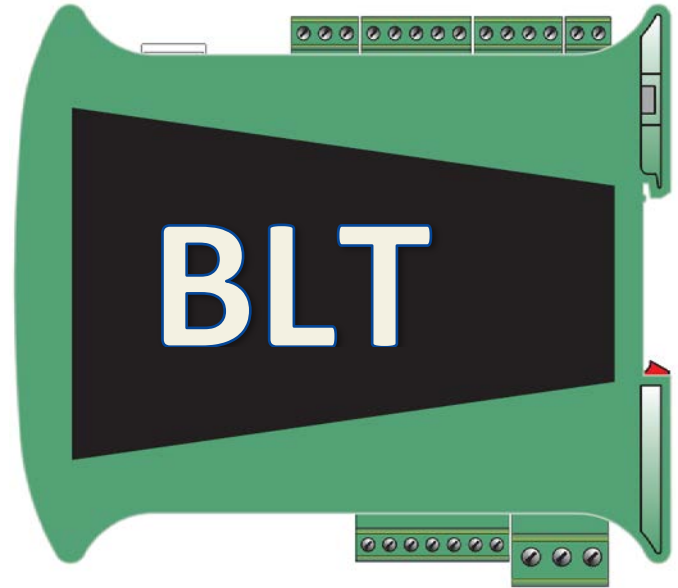

PENKO

an ETC Company

SGM800 Belt Weigher

Table of Contents

1	Introduction	3
2	Indication of display	4
3	Explanation of front keys	5
4	Configure and control	6
4.1	PENKO configuration software	6
4.2	Industrial protocols	7
5	Parameters.....	8
5.1	Configuration parameters	8
5.2	Recipe parameters.....	10
5.3	Live process parameters.....	10
6	Inputs and outputs	12
6.1	Inputs.....	12
6.2	Outputs.....	12
7	Printer Ticket.....	13
8	Program basics	14
9	Default settings	16



SGM800 Belt Weigher

1 Introduction

This manual is applicable for the following Belt Weigher devices:

- SGM820 Ethernet BLT
- SGM830 CAN BLT
- SGM840 Profibus BLT
- SGM850 Serial BLT
- SGM860 Profinet BLT

To configure and control the Belt Weigher, the following options are available:

Full control:

- PENKO Pi Mach II software
- PENKO PDI Client software
- Modbus protocol
- Profibus protocol
- EtherNet/IP protocol
- ASCII protocol
- Profinet protocol

Basic control:

- Fins protocol*
- PENKO TP protocol*

** Register functions not available*

Note:

This manual does not describe the basic functionality of the device. Consult the device manual for this.

SGM800 Belt Weigher

2 Indication of display

The SGM with closed cover:



- | | | | |
|----|----------------|---|---------------------|
| 1 | Weigher stable | 4 | Output active 1 - 4 |
| 2* | Zero active | 5 | Weigher value |
| 3* | Tare active | | |

* When the belt weigher program is active, LED 2 and 3 are blinking

The SGM with open cover:



- | | | | | | |
|---|---------------------|-------------------|---|---------------------|-------------------|
| 1 | key 1 press <2sec.= | 1
SHORT | 3 | key 3 press <2sec.= | 3
SHORT |
| | key 1 press >2sec.= | 1
LONG | | key 3 press >2sec.= | 3
LONG |
| 2 | key 2 press <2sec.= | 2
SHORT | | | |
| | key 2 press >2sec.= | 2
LONG | | | |

Function of these keys are described on the next page

SGM800 Belt Weigher

3 Explanation of front keys

All keys have different functions depending on weighing, menu or program mode.



Pressing key 1 "short".

In Weighing mode: create a new zero level

In Menu mode: increase value by 1 or move up in menu

In running mode: disabled



Pressing key 1 "long".

In Weighing mode: reset zero level to the original zero level

In Menu mode: decrease value by 1 or move down in menu

In running mode: disabled



Pressing key 2 "short".

In Weighing mode: set/ reset tare and reset preset tare

In Menu mode: go into sub-menu or move cursor 1 position to the left

In running mode: disabled



Pressing key 2 "long".

In Weighing mode: set preset tare

In Menu mode: move cursor 1 position to the right

In running mode: disabled



Pressing key 3 "short".

In Weighing mode: enter menu

In Menu mode: escape move back in menu without saving changes

In running mode: disabled



Pressing key 3 "long".

In Weighing mode: enter configuration menu

In Menu mode: Confirm made changes

In running mode: disabled

Menu will jump back one level every 30 seconds of inactivity

SGM800 Belt Weigher

4 Configure and control

To configure and control the Belt Weigher, the following options are available:

- PENKO configuration software
- Industrial protocols

4.1 PENKO configuration software

PENKO Pi Mach II and PENKO PDI Client can be downloaded from www.penko.com



USB driver and user manual are included in the download

Pi Mach II supports USB and Ethernet connection. PDI Client is USB only.

Consult the manuals on how to install and connect to the device.

In the tree structure of the device, the configuration parameters are found at:

PENKO - Device root - SGM800 - System Setup - Configuration

Configuration parameters

	Flow Point Pos. <input type="text" value="000000"/>	Weight per Pulse <input type="text" value="0"/> kg
	Totals Point Pos. <input type="text" value="000000"/>	Correction <input type="text" value="1,000"/> *
	Max Flow <input type="text" value="0"/> kg/h	Pulses per Meter <input type="text" value="0"/>
	Dynamic Tare Band <input type="text" value="0,0"/> %	Fixed Speed <input type="text" value="0"/> kg/h
	Dynamic Tare Time <input type="text" value="0,00"/> s	Measurement Method <input type="text" value="Beltweigher"/>
	Zero Suppress <input type="text" value="0"/> kg/h	Analogue Use <input type="text" value="Flow Measurement"/>
	Filter Time <input type="text" value="0,00"/> s	Control Correction <input type="text" value="0"/> %

The parameters are explained in [chapters 5](#)

SGM800 Belt Weigher

In the tree structure of the device, the recipe parameters are found at:

PENKO - Device root - SGM800 - Recipe

Recipe parameters

The screenshot shows a configuration tree on the left and four parameter input fields on the right. The tree structure is as follows:

- PENKO
 - Device root
 - SGM820 Ethernet
 - 1.1.1.1 Name =
 - 1.1.1.2 Start Quick setup
 - 1.1.1.3 Enable Full setup
 - Live
 - System
 - System Setup
 - Service
 - Indicator
 - Communication
 - Digital inputs
 - Digital outputs
 - Analog output
 - Clock
 - Printer
 - Configuration
 - Factory recall
 - WELMEC
 - Recipe**
 - Control
 - Access

The parameters on the right are:

- Batch: kg
- Low Flow Level: kg/h
- High Flow Level: kg/h
- Setpoint Flow: kg/h

The parameters are explained in [chapters 5](#)

4.2 Industrial protocols

The PENKO protocols Modbus, Profibus, EtherNet/IP and ASCII have a function set called register functions. These functions allow the user to configure and control the device.

Protocol descriptions can be downloaded from www.penko.com

Consult these on how to connect the device and use the register functions.

	SGM800	SGM810	SGM820	SGM840	SGM850	SGM860
Modbus TCP			✓			
Modbus SERIAL					✓	
Profibus				✓		
EtherNet/IP			✓			
ASCII TCP			✓			
ASCII SERIAL					✓	
Profinet IO						✓

Note: the FINS and PENKO TP protocol do not support register functions, only basic read and write operations for markers and registers.



SGM800 Belt Weigher

5 Parameters

These parameters correspond with the parameters in the tree structure of the device Recipe. When using the industrial protocol register functions, each parameter can be reached using its number.

Some parameters can be reached directly using ASCII, TP protocol, Modbus RTU, Modbus TCP, Fins, Profibus, Profinet or EtherNet/IP. The parameters for Profibus or EtherNet/IP are prefixed with **PB** or **EIP**.

The Profinet config parameters can be found in the PENKO Profinet Protocol manual.

Note: when the device is rebooted or the recipe is manually changed, all recipe parameters are changed back to the value that were last set manually in the recipe.

5.1 Configuration parameters

No.	Name	Description
1	Flow point position	The decimal point position for the flow indications.
2	Totals point position	The decimal point position for the totals indications.
3	Max flow	The maximum allowed flow. The analog output can signal the flow as a percentage of the maximum flow.
4	Dynamic tare band	Within this range a Dynamic Tare Measurement is allowed. This range is entered as a percentage of the maximum flow. For instants if there is a piece of product sticking to the belt. A new tare point can be set and it will show "0" again. If the new tare is outside the dynamic tare band range, alarm (output 1) is turned off.
5	Dynamic tare time	During this time the weight of the empty belt is sampled. The average weight is subtracted to correct the displayed weight. For best result, enter the number of seconds the belt takes to complete one revolution.
6	Zero suppression	The lowest allowed flow on the belt. Below this level, the flow is forced to zero and it will show that there is nothing on the belt. For example; if zero suppress is set to 1.000kg, every weight below 1.000kg will show as 0.000kg and every weight above 1.000kg will show as the actual weight.
7	Filter time	Time for filling the filter with one new value. 10 values are averaged to stabilize the flow display value.

SGM800 Belt Weigher

8	Weight per Pulse	Weight indicated by one pulse of the PLC pulse output (Output 4). The pulse duration is 0.5s. For example; when set to 5.000kg, the device will send out a pulse after every 5.000kg. The fastest pulse time is 1Hz (0.5 sec high and 0.5 sec low).
9	Correction	Used to correct deviations in the total dosed amount by compensating for mechanical variations. When the final dosed amount is checked by weighing the resulting weight, the device can recalculate this factor by calculating: $new\ correction = checked\ batch\ total \times \frac{correction}{last\ hatch\ total}$ After the calculation, both totals are equal.
10	Pulses per Meter	The number of pulses the tachometer generates per meter.
11	Fixed speed	When 0 is entered, the tachometer input is used to calculate the belt speed. When a fixed speed is entered, the tachometer input is used as a belt on signal.
12	Measurement method	The used flow measurement system. <ul style="list-style-type: none"> • Beltweigher => configure with the above settings • Impact flow meter => this has no moving parts so a fixed speed setting of 1 m/s and no pulse input are used.
13	Analog use	Select if the flow is measured or that the flow is regulated using the DAC. <ul style="list-style-type: none"> • Flow measurement => no regulation by the DAC • Flow regulation => the flow is regulated by the DAC
14	Control correction	When flow regulation is selected, this is the percentage that the analog control signal can be influenced by the flow regulation.
15	Use alibi memory	Select if a result must be written to the internal alibi memory.

SGM800 Belt Weigher

5.2 Recipe parameters

These parameters correspond with the parameters in the tree structure of the device Recipe. When using the industrial protocol register functions, each parameter can be reached using its number.

Some parameters can be reached directly using ASCII, TP protocol, Modbus RTU, Modbus TCP, Fins, Profibus or EtherNet/IP. The parameters for Profibus or EtherNet/IP are prefixed with **PB** or **EIP**.

Note: when the device is rebooted or the recipe is manually changed, all recipe parameters are changed back to the value that were last set manually in the recipe.

No.	Name	Description	Location
1	Batch total	Required batch total to dose. When the set amount is reached output 2 turns off.	PB-R85 EIP-R11
2	Low flow	When the Flow is above 'Low level' and below 'High Level', the Flow is OK and Output 3 is on.	PB-R87 EIP-R13
3	High flow	When the Flow is above 'Low level' and below 'High Level', the Flow is OK and Output 3 is on.	PB-R86 EIP-R12
4	Setpoint flow	Setpoint for the Flow regulation. Only available when Flow regulation is selected.	PB-R88 EIP-R14

5.3 Live process parameters

When using the industrial protocol register functions, each parameter can be read using its number.

Example: to read the value of low level, Use the function code 701 and value 1.

No.	Name	Description
1	Net weight value	Get the actual filtered and net weight of the belt
2	Total	Get the actual total weight of the batch
3	Flow in kg/h	Get the actual flow of the product
4	Flow/Control	When analog use is set to flow measurement, the actual flow is shown as a percentage of the maximum flow.

SGM800 Belt Weigher

		When analog use is set to flow regulation, the analog output is shown in a percentage. This percentage is used to control the flow per hour, to get the flow per hour as close as possible to the setpoint flow.
5	Net weight value * 10	Get the actual filtered and net weight * 10 of the belt
6	Reserved	
7	Reserved	
8	Reserved	
9	Reserved	
10	Reserved	
11	Reserved	
12	Reserved	
13	Reserved	
14	Reserved	
15	Reserved	
16	Reserved	
17	Reserved	
18	Reserved	
19	Reserved	
20	Reserved	
21	Max flow	Get the maximum allowed flow
22	dynamic tare band	Get the dynamic tare band
23	dynamic tare time	Get the dynamic tare time
24	Flow point position	Get the decimal point position for the flow indications
25	Totals point position	Get the decimal point position for the totals indications
26	Batch total	Get the batch total
27	High flow	Get the high flow
28	Low flow	Get the low flow
29	Setpoint flow	Get the setpoint flow
30	Reserved	
31	Speed in m/s	Get the speed of the belt
32	Reserved	

SGM800 Belt Weigher

6 Inputs and outputs

The following inputs and outputs are used.

6.1 Inputs

Input	Name	Description	Profibus marker	EtherNet/IP marker
1	Start/Stop or Tachometer	The tachometer input which is used to measure the belt speed. When the belt speed is not used, a preset speed is entered and this input is used to start and stop dosing.	969	433
2	Dynamic tare	Start the Dynamic tare level measurement. During this measurement the average weight of the empty belt is determined.	970	434
3	Zero	Reset the total to zero.	971	435
	Total	The controller reads the batch total it receives from Profibus or EtherNet/IP.	972	436
	Flow OK	The controller reads the flow (low and high level) it receives from Profibus or EtherNet/IP.	973	437
	Setpoint	The controller reads the setpoint for the flow regulation it receives from Profibus or EtherNet/IP (only when flow regulation is selected).	974	438

6.2 Outputs

Output	Name	Description
1	Live/Alarm	Active when the controller is on. The output is turned off when an alarm situation occurs like overload, underload or dynamic zero fail.
2	Busy	Turned off when the batch total amount is reached.
3	Flow OK	Indicate if the flow is within its limits. The high and low limits can be set in the recipe.
4	Weight Pulse	Pulsed high for 0.5 seconds when a preset amount has been dosed. The dosed amount per pulse can be set in the configuration menu.

SGM800 Belt Weigher

Analog out	Flow/Control	Depending on the configuration, this output can indicate or regulate the flow from 0.00% to 100.00% The DAC source can also be changed as described in the SGM manual. This way the output can also be used to signal dosed amount or belt weight.
-------------------	--------------	--

7 Printer Ticket

Example of the SGM Printer recipe when 'Ticket' layout is selected.

```
Programmable header 1
Programmable header 2
Programmable header 3
Programmable header 4
-----
---
DATE                07-10-11
TIME                05:57.13
RECIPE              001
TICKETS             100

DOSED                00000.00 kg
COUNT              100
-----
---
```

SGM800 Belt Weigher

8 Program basics

This chapter describes a few basics of the Belt Weigher program which can be used when starting the program for the first time.

With input 1 you can **Start** (input high) and **Stop** (input low) the SGM. If you use a tachometer the SGM will start if the tachometer starts.

The SGM should start measuring the flow if the flow is above the **Zero Suppression**. If the weight is below the **Zero Suppression**, the weight will be set to zero.

The **Correction Factor** must be set to 1.000, this means that there is no correction.


If you start the SGM for the first time you must follow these steps:

1. Start a Dynamic tare, if you get an alarm, set the weight to zero and start a new Dynamic tare. If the Dynamic tare went OK, proceed to step 2.
2. Let the SGM run without any product on the belt for a couple of minutes, the total should stay zero.
3. Let the SGM run with product on the belt and preform a correction (see page 12).

The analog output can send out the flow, or the weight, but the analog output can also be selected as a regulated output. The flow kg/h you have set is then maintained with the analog output.

You can set the 'analog use' to **Regulation** instead of **Measurement** in the **Configuration**. If you set the analog us to Regulation you can set the **Setpoint Flow** (in the Recipe) to the desired flow. The analog output must be set to **Control**.

SGM800 Belt Weigher

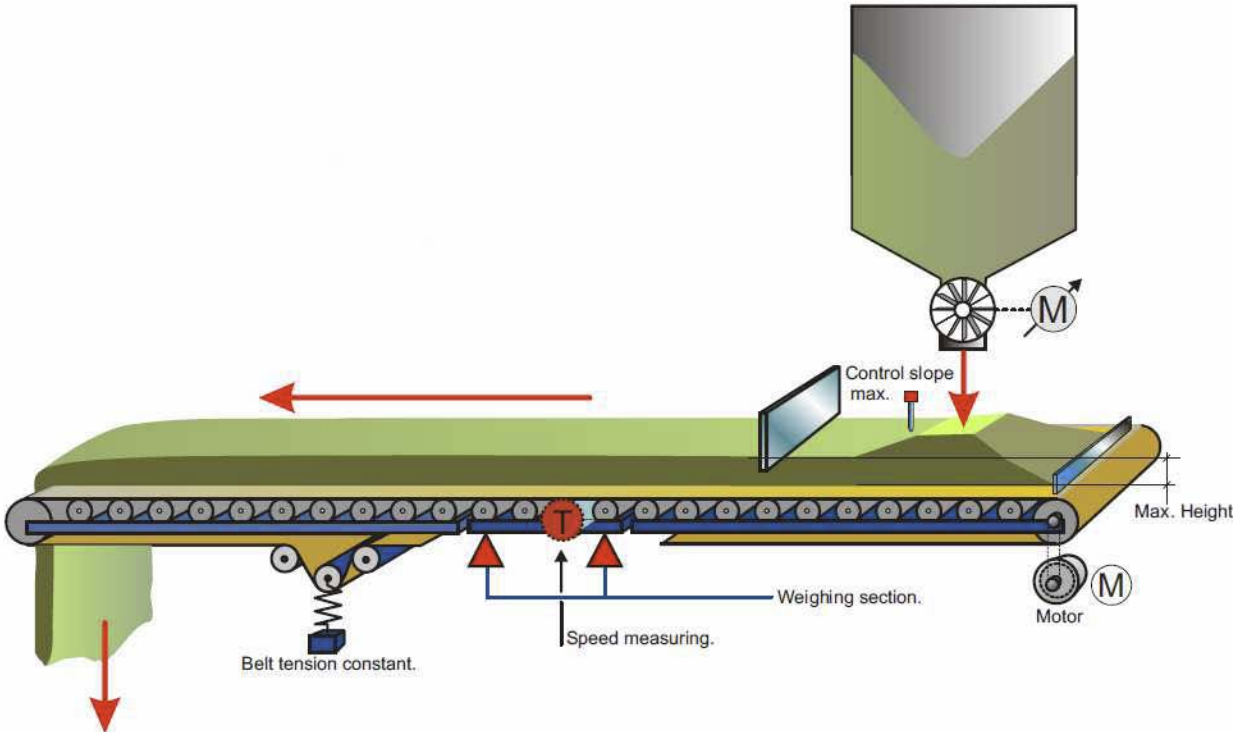

SGM800 Belt Weigher

9 Default settings

Configuration

Configuration	Setting
Flow Point Position	0.0
Totals Point Position	none
Max Flow	4000.0 kg/h
Dynamic Tare Band	10%
Dynamic Tare Time	30 sec
Zero Suppress	0.5 kg
Filter Time	1.0 sec
Weight per Pulse	10 kg
Correction	1.000
Pulses per Meter	0
Fixed Speed	1.000 m/sec
Measurement Method	Belt Weigher
Analogue Use	Flow Regulation
Control Correction	2%

DAC

DAC setup	Setting
Indicator	Control %
Min	0.00%
Max	100.00%
Mode	4 – 20 mA
Dynamic Tare Time	30 sec

SGM800 Belt Weigher

Weigher

Weigher	Setting
Name	SGM Belt
Unit Label	Kg
Step	1
Decimal point	0.000
Operation Mode	Industrial
Max Load	100.000

Stable

Stable Condition	Setting
Range	0.010 kg
Time	1.00 sec

Filter

Filter Digital	Setting
Digital Filter	Dynamic App.
Cutoff Frequency	1.0 Hz
Frequency	10 Hz



About PENKO

At PENKO Engineering we specialize in weighing. Weighing is inherently chemically correct, independent of consistency, type or temperature of the raw material. This means that weighing any kind of material guarantees consistency and thus, it is essential to sustainable revenue generation in any industry. As a well-established and proven solution provider, we strive for the ultimate satisfaction of custom design and/or standard applications, increasing your efficiencies and saving you time, saving you money.

Whether we are weighing raw materials, components in batching, ingredients for mixing or dosing processes, - or weighing of static containers and silos, or - in-motion weighing of railway wagons or trucks, by whatever means required during a process, we are essentially forming vital linkages between processes and businesses, anywhere at any time. We design, develop and manufacture state of the art technologically advanced systems in accordance with your strategy and vision. From the initial design brief, we take a fresh approach and a holistic view of every project, managing, supporting and/or implementing your system every step of the way. Curious to know how we do it? www.penko.com

Certifications

PENKO sets high standards for its products and product performance which are tested, certified and approved by independent expert and government organizations to ensure they meet – and even – exceed metrology industry guidelines. A library of testing certificates is available for reference on:

www.penko.com/nl/publications_certificates.html



PENKO Professional Services

PENKO is committed to ensuring every system is installed, tested, programmed, commissioned and operational to client specifications. Our engineers, at our weighing center in Ede, Netherlands, as well as our distributors around the world, strive to solve most weighing-system issues within the same day. On a monthly basis PENKO offers free training classes to anyone interested in exploring modern, high-speed weighing instruments and solutions. Training sessions on request: www.penko.com/training

PENKO Alliances

PENKO's worldwide network: Australia, Brazil, China, Denmark, Germany, Egypt, Finland, France, India, Italy, Netherlands, Norway, Poland, Portugal, Slovakia, Spain, Syria, Turkey, United Kingdom, South Africa, Slovakia Sweden and Switzerland, Singapore.

A complete overview you will find on: www.penko.com/distributor

